




Thermal Resources Management (TRM) Inc.
 175 Idema Road, Markham, ON, Canada, L3R 1A9
 Tel: 1-905-940-4737 Fax: 1-905-940-4731
 ryan@trmheatingcables.com
 www.trmheatingcables.com

MI Heating Cable – Typical Trench Drain – Separate from Ramp exiting through Trench Base Cross Section

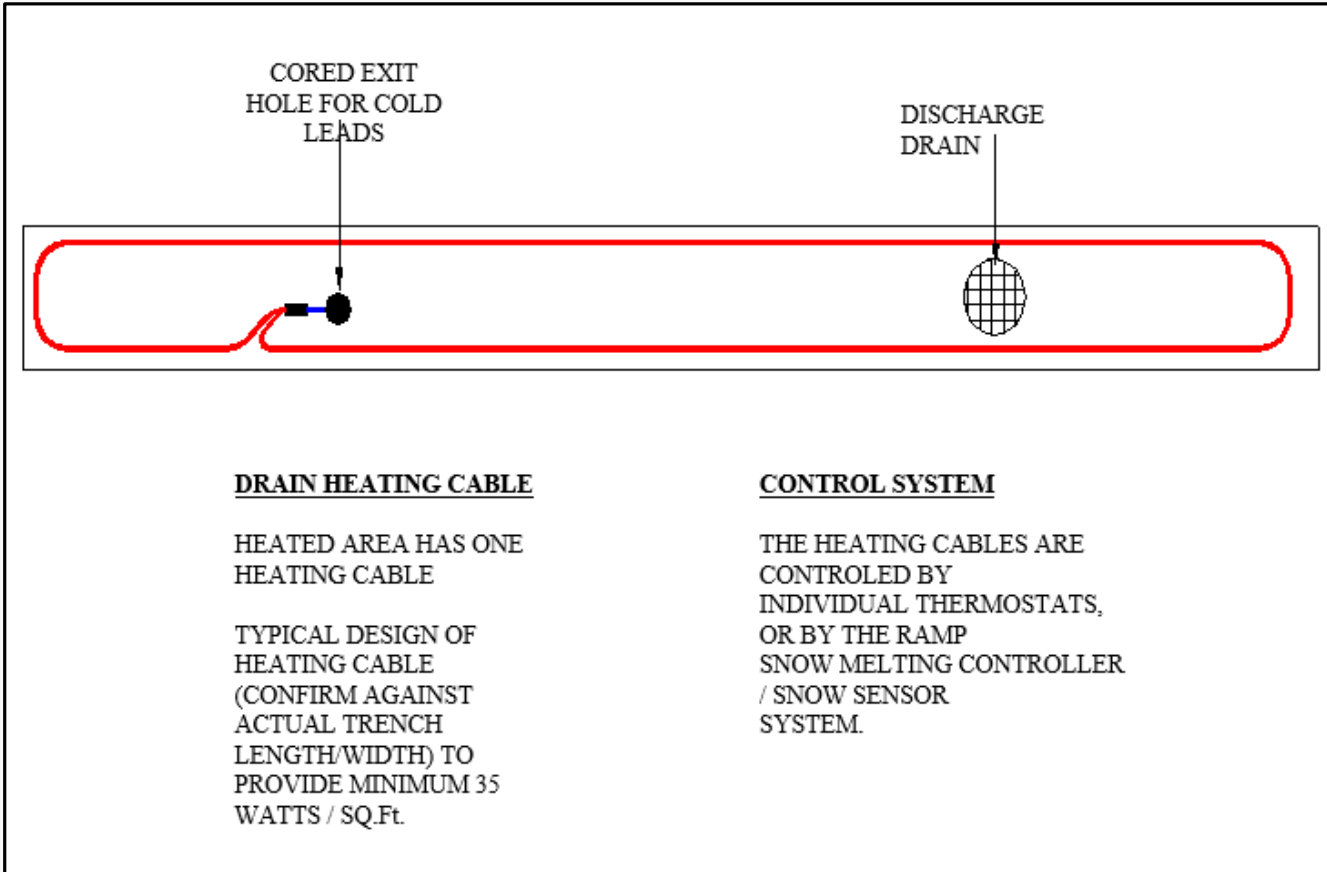


DRAIN HEATING CABLE

HEATED AREA HAS ONE HEATING CABLE

TYPICAL DESIGN OF HEATING CABLE (CONFIRM AGAINST ACTUAL TRENCH LENGTH/WIDTH) TO PROVIDE MINIMUM 35 WATTS / SQ.Ft.

CONTROL SYSTEM

THE HEATING CABLES ARE CONTROLLED BY INDIVIDUAL THERMOSTATS, OR BY THE RAMP SNOW MELTING CONTROLLER / SNOW SENSOR SYSTEM.

Drawing Number:	Scale: N.T.S.	Project Status: Construction	
 Thermal Resources Management TRM Heating Cables	Drawn by: IP	Approved: _____	
		Date of issue:	
		Rev.: 0	Page: