





Thermal Resources Management (TRM) Inc.  
 175 Idema Road, Markham, ON, Canada, L3R 1A9  
 Tel: 1-905-940-4737 Fax: 1-905-940-4731  
 ryan@trmheatingcables.com  
 www.trmheatingcables.com

## MI Heating Cable – Typical Prefabricated Trench Drain – Separate from Ramp exiting through side wall Cross Section

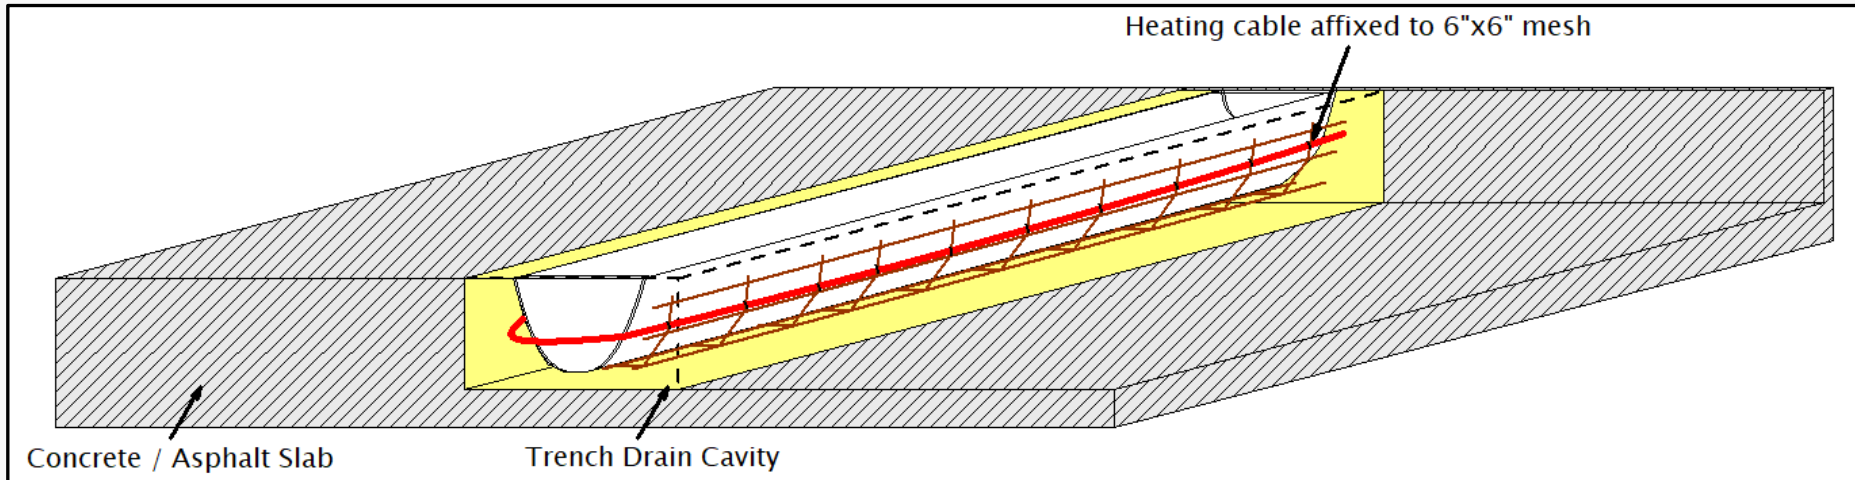

### Pre-Fabricated Trench Drain Notes:

- Trench to be heated by 2 runs of Heating Cable.
- The trench drain cavity must accommodate the trench drain vessel with 2-3" of clearance on all sides/bottom.
- Heating Cable to be attached to 6"x6" mesh which has been suspended within the trench cavity, allowing 2-3" distance from the heating cables to the outside of the trench drain vessel.
- Trench drain cavity (including mesh/ heating cable) must be filled with hydraulic cement, ensuring the heating cable is full embedded approx. 2-3" away from the trench drain vessel.
- Designed output: 40 Watts / Ft<sup>2</sup>

<b>Drawing Number:</b>	<b>Scale: N.T.S.</b>	<b>Project Status: Construction</b>	
 <b>Thermal Resources Management TRM Heating Cables</b>	<b>Drawn by: IP</b>	<b>Approved: _____</b>	
		<b>Date of issue: July 28, 2020</b>	
		<b>Rev.: 0</b>	<b>Page:</b>